



ADDENDUM NO. 1
January 29, 2019

Cottonwood Trail: Renovate and Expand
Oahe Downstream Recreation Area
Stanley County, South Dakota
Project No. Down19Pa

Bid Opening Date: February 7, 2019, 3:00 PM CT

Department of Game, Fish and Parks
2nd Floor, Foss Building
523 East Capitol
Pierre, South Dakota 57501-3182

Owner: State of South Dakota
Department of Game, Fish and Parks

Scope of this Addendum:

The following becomes a part of the original plans and specifications, taking precedence over the items that may conflict. The bidder shall note receipt and make acknowledgment of the addendum on his bid form, incorporating its provisions in his bid.

Item No. 1: Addition of sheet No. 5A – Longitudinal Pedestrian Barrier

January 29, 2019



Jacob Rosecky
Engineer III


LONGITUDINAL PEDESTRIAN BARRIER

When exposed to vehicular traffic, Longitudinal Pedestrian Barrier shall be crashworthy, and the bottom and top surfaces of the traffic side of devices shall have retroreflective sheeting or delineation for improved nighttime visibility.

When Longitudinal Pedestrian Barriers are combined in a series, the maximum gap between devices that do not interlock shall be one inch. Joints between devices that do interlock should be closed and flush to prevent canes or small wheels from being trapped and to facilitate safe hand trailing. Channelizing devices should provide a color contrasting pattern. Black should not be used to color any base on a device. The devices should comply with the general color and stripe pattern requirements of Chapter 6F of the MUTCD.

Longitudinal Pedestrian Barriers shall have continuous bottom and top surfaces. The lower edge of the bottom portion shall be a maximum of 2 inches above the walkway. The top edge of the bottom portion shall be a minimum of 8 inches above the walkway. The top of the top portion shall be a minimum of 32 inches above the walkway. The top surface shall be smooth to allow safe hand trailing.

All costs shall be incidental to the contract unit price per foot for LONGITUDINAL PEDESTRIAN BARRIER.

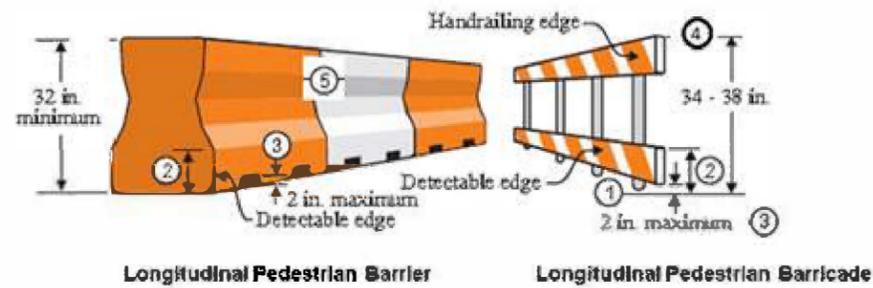

1. Barricade rail supports may not extend into the pedestrian walkway more than 4 inches from the face of the barricade.
2. The top edge of the bottom portion shall be a minimum of 8 inches above the walkway.
3. Devices shall not block water drainage from the walkway. A gap height or opening from the walkway surface up to a maximum of 2 inches in height is allowed for drainage purposes.
4. The top edge of the Longitudinal Pedestrian Barricade is to be used as a guiderail to provide visual and tactile guidance to pedestrians along a designated route. The top surface should have a minimum width of 0.5 inches to allow the hand to feel the surface. The surface should be smooth and free of any sharp or abrasive elements to allow safe hand trailing.
5. Longitudinal Pedestrian Barrier used to provide positive protection from traffic to pedestrians should be crashworthy.
6. When either device is combined in a series, the maximum gap between devices that do not interlock shall be 1 inch. Joints between devices that do interlock should be closed and flush to prevent canes or small wheels from being trapped and to facilitate safe hand trailing.

		Department of Game, Fish & Parks	Division of Administration Foss Building 523 E. Capitol Ave. Pierre, South Dakota 57501-3182 Phone: (605) 773 - 6082
PROJECT NAME: Down 19Pa DRAWN BY: JJR CHECKED BY:	DATE: 01/29/2019 REVISION:	Cottonwood Trail: Renovate & Expand	
PAGE: 5A OF: 16			